

48 x 48 TIMERS

MULTI-FUNCTION TIMERS



Our 48 x 48 Timers are panel mount/plug-in-function timers and are fully programmable and microprocessor driven to ensure the highest degree of accuracy. The 48T-100 incorporates six different functions and eight overlapping time ranges, ranging from 0,1 seconds to 100 hours, as well as inputs for Start, Reset and Gate.

Index

48-T100: Multi-function Timer	62
48-T101: Delay On/Interval (One Shot) Timer	64
How to Order	66





ORDERING CODE

TYPE	MODEL	PINS	VOLTAGE	POWER SUPPLY
48	T100	11	230	A

SEE PAGE 66 FOR ORDERING OPTIONS

Application Examples

- Delayed energisation of loads on power-up.
- Switching loads on and off repetitively in equal intervals.
- Delayed release after limit switch operation.
- Off delay timer in conveyor and numerous similar applications.
- Energisation of loads for a set period of time.
- Alternating operation of two loads in equal intervals.
- Sequential switching of loads.

Features

- Power supply ordering options: 100 to 230V AC, 24V AC/DC or 12V DC.
- Six programmable timing functions.
- Separate Start, Reset and Gate inputs.
- Polarity protection on inputs.
- Extra short housing.
- DPDT relay supplied as standard (5A per contact)
- Microprocessor technology based.
- High repetitive and setting accuracy.
- Automatic (i.e. power up) pulse or hold start.
- Power ON and Relay ON LED's.
- Front dial can be used as a screwdriver for adjusting the operational settings.
- Flashing Power ON LED when unit is timing (flash rate increases when relay is about to switch).

Description of Operation

The **48-T100** is a fully programmable, microprocessor based multi-function timer, incorporating 6 overlapping time ranges within 0.1 second to 100 hours. The unit has independent Start, Reset and Gate inputs which can be individually activated by connecting each selected input pin to pin 2 (common).

Before operation, the timer can be programmed to operate in any of the following modes:

A: Delayed ON Operation, Pulse Start: At power up the relay is de-energised. Timing only commences on activation of the start input. After the set time expires, the relay energises. The relay remains energised until either the reset input is activated or the power supply is interrupted for more than 0.1 second.

B1: Symmetrical Recycling, First Cycle OFF Operation: At power up, the relay is de-energised. On activation of the start input, the relay will switch on and off repetitively starting with the OFF cycle. The relay de-energises and/or remains de-energised if either the reset input is activated or power supply is interrupted for at least 0.1 second. The duration of the ON cycle and the OFF cycle are both equal to the set time.

B2: Symmetrical Recycling, First Cycle ON Operation: At power up, the relay is de-energised. On activation of the start input, the relay will switch on and off repetitively, starting with the ON cycle. The relay de-energises and/or remains de-energised if either the reset input is activated or power supply is interrupted for at least 0.1 second. The duration of the ON cycle and the OFF cycle are both equal to the set time.

C: Signal ON/OFF Delay: At power up the relay is de-energised. On activation of the start input, the relay energises and timing commences. After the set time

expires, the relay de-energises. On release of the start input, the relay energises and timing commences again. After the set time expires, the relay de-energises again.

D: Interval Operation, Hold Start: At power up the relay is de-energised. On activation of the start input, the relay energises. Timing will only commence on the release of the start input. After the set time expires, the relay de-energises.

E: Interval Operation, Pulse Start: At power up the relay is de-energised. On activation of the start input, the relay energises and timing commences. After the set time expires, the relay de-energises. When the start input is re-activated, the relay once again energises and the timing cycle begins.


Gate Input: When the Gate Input is activated, the unit stops timing. Timing only resumes once the Gate Input is released. The set time is thus extended by the time the Gate Input is activated. Gate input acts as a stop clock or pause button.

Notes:

1. If the start-input pin 6 is linked permanently to pin 2, the unit will start timing immediately on power up.
2. Start, Reset and Gate inputs must be activated via potential-free contacts between the relevant input pin and pin 2 (common).
3. The Start, Reset and Gate inputs are all electronically protected (i.e.: connection of any one of the input pins to pin 10 will not damage the unit).
4. Function Test Mode is achieved by adjusting the dial fully anti-clockwise. This will result in the unit performing the set function with a time base (t) = 5 sec.

Operational Diagrams

Function A: Delay ON Operation

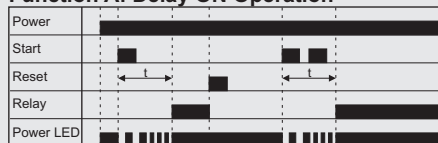

Function B1: Symmetrical Recycling, First Cycle OFF Operation



t = Preset time

Function B2: Symmetrical Recycling, First Cycle ON Operation



Function C: Signal ON/OFF




a = a < t

Function D: Interval Operation




Function E: Interval Operation

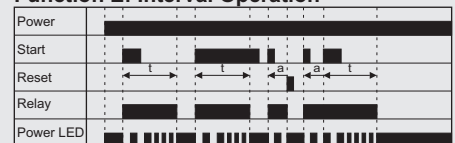

Gate Input= Acts as a Stop Clock or Pause Button.

Description of Controls

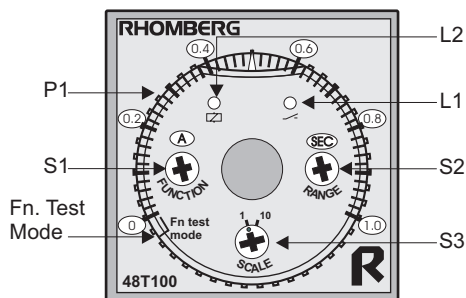

L1: The red “RELAY ON” LED illuminates  when the relay is energised.

L2: The green “POWER ON” LED illuminates  when power is supplied to the unit. This LED flashes when the unit is timing. The flash rates increase just before the relay switches.

S1: The **Time Function** is set on S1.
 Position A: Delayed ON Operation, Pulse Start
 Position B1: Symmetrical Recycling, OFF Cycle First
 Position B2: Symmetrical Recycling, ON Cycle First
 Position C: Signal ON/OFF Delay
 Position D: Interval Operation, Hold Start
 Position E: Interval Operation, Pulse Start

S2: The **Time Range** is set on S2. The 4 available time settings are SECONDS, MINUTES, HOURS and 10 HOURS.

S3: Two dial **scales** are selectable on S3.
 Position 1 adjusts the scale to have a range from 0 to 1.
 Position 10 adjusts the scale to have a range from 0 to 10.

P1: The **Time Setting** is adjusted on P1.

Fn Test Mode: When the dial, P1 is adjusted fully anticlock-wise, the unit will perform the set function with a time base (t) = 5 sec.


See page 94 for Dimensional Diagram.

Wiring and Connection

Relay Contacts-DPDT		
CONTACT1	Normally Open	1 + 3
	Normally Closed	1 + 4
CONTACT2	Normally Open	11 + 9
	Normally Closed	11 + 8

Power Supply	
Phase/Positive	10
Neutral/Negative	2

Input	
Start	6
Reset	7
Gate	5
Common	2

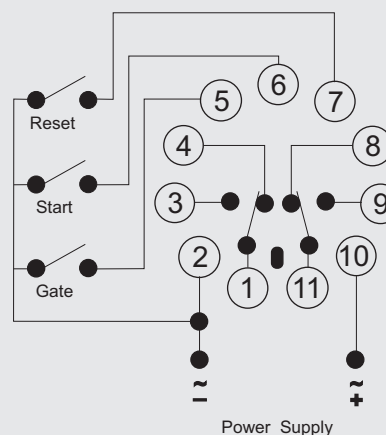

Note: The positions of the relay contacts are shown in the de-energised state.

Technical Specifications

POWER SUPPLY			
Supply Voltage	100 to 230VAC	24 VAC/DC	12VDC
Power Consumption	3 VA	2 VA (AC) 1W (DC)	1.5W
Supply Tolerance	±10%	±10%	±10%
Power Reset	100 msec minimum		

GENERAL SPECIFICATIONS	
Relay Contacts	2 x 5A @ 250VAC
Standards	CE Rated
Enclosure Protection Rating	IP40
Weight	100gm (approximately)

START, RESET and GATE INPUTS	
Start Activation	On connecting pin 6 to pin 2
Reset Activation	On connecting pin 7 to pin 2
Gate Activation	On connecting pin 5 to pin 2
Input Protection	Connecting input pins to pin 10 instead of pin 2 will not damage the unit. However the input will not be recognised by the unit.
Input Signal	50 msec minimum

TIME SPECIFICATION	
Setting Accuracy	Maximum of ±5% full scale ±50msec
Repeatability	Maximum of ±0.3% of full scale ±10msec (in 1 sec time range)
Temperature Influence	Maximum of ±2% of full scale
Influence of Supply Voltage Variance	Maximum of ±0.5% of full scale ±10msec (in 1 sec time range)
Power Reset Time	100msec minimum
Input Reset Time	50msec minimum

SETTINGS		
Time Setting	Scale Setting	
	1	10
Sec	0.1 sec to 1 sec	1 sec to 10 sec
Min	0.1 min to 1 min	1 min to 10 min
Hrs	0.1 hr to 1 hr	1 hr to 10 hrs
10 Hrs	1 hr to 10 hrs	10 hrs to 100 hrs

Note: Function Test Mode is achieved by adjusting the dial fully anti-clockwise. This will result in the unit performing the set function with a time base (t) = 5 sec.

Additional information in Section J, page 131.

48-T101

Delayed On/Interval (One Shot) Timer

48 X 48 TIMERS

MULTI-FUNCTION TIMERS



ORDERING CODE

TYPE	MODEL	PINS	VOLTAGE	POWER SUPPLY
48	T101	11	230	A

SEE PAGE 66 FOR ORDERING OPTIONS

Application Examples

- Delayed energisation of loads on power up.
- Sequential switching of loads.
- Energisation of loads for a set period of time.

Features

- Power supply ordering options: 100 to 240V AC, 24VAC/DC or 12V DC.
- Microprocessor technology based.
- Power ON and Relay ON LED's.
- Front dial can be used as a screwdriver for adjusting the operational settings.
- Extra short housing.
- Time settings from 0.1 second up to 100 hours, in 8 overlapping time ranges.
- Automatic (i.e. power up) pulse or hold start.
- DPDT relay supplied as standard (5A per contact).
- Flashing Power ON LED when unit is timing (flash rate increases when relay is about to switch).

Description of Operation

The **48-T101** is a microprocessor based delayed on/interval (one shot) timer, incorporating 6 overlapping time ranges within 0.1 second and 100 hours. The unit is automatically triggered at power up.

Before operation, the timer can be programmed to operate in any of the following modes:


A: Delayed ON Operation: At power up, the relay is de-energised and timing commences. After the set time expires, the relay energises and remains energised until power is removed.

B: Interval (One Shot) Operation: At power up, the relay energises and timing commences. After the set time expires, the relay de-energises.


Note: Function Test Mode is achieved by adjusting the dial fully anti-clockwise. This will result in the unit performing the set function with a time base (t) = 5 sec.

Operational Diagrams

Function A: Delay ON Operation




Function B: Interval (One Shot) Operation



t = Preset time

Description of Controls

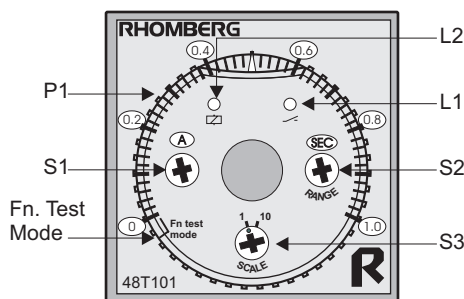

L1: The red “RELAY ON” LED illuminates  when the relay is energised.

L2: The green “POWER ON” LED illuminates  when power is supplied to the unit. This LED flashes when the unit is timing. The flash rates increase just before the relay switches.

S1: The **Time Function** is set on S1.
Position A: Delayed ON Operation
Position B: Interval (One Shot) Operation

S2: The **Time Range** is set on S2. The 4 available time settings are SECONDS, MINUTES, HOURS and 10 HOURS.

S3: Two dial **scales** are selectable on S3.
Position 1 adjusts the scale to have a range from 0 to 1.
Position 10 adjusts the scale to have a range from 0 to 10.

P1: The **Time Setting** is adjusted on P1.



Fn Test Mode: When the dial, P1 is adjusted fully anticlock-wise, the unit will perform the set function with a time base (t) = 5 sec.

See Section J: General Information, page 94 for Dimensional Diagram.

Wiring and Connection

Relay Contacts-DPDT		11-Pin	8-Pin
CONTACT1	Normally Open	1 + 3	1 + 3
	Normally Closed	1 + 4	1 + 4
CONTACT2	Normally Open	11 + 9	8 + 6
	Normally Closed	11 + 8	8 + 5

Power Supply	11-Pin	8-Pin
Phase/Positive	10	7
Neutral/Negative	2	2

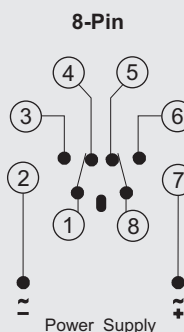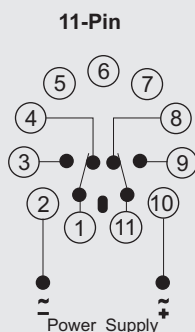

Note: The positions of the relay contacts are shown in the de-energised state.

Technical Specifications

POWER SUPPLY			
Supply Voltage	100 to 230VAC	24 VAC/DC	12VDC
Power Consumption	3 VA	2 VA (AC) 1W (DC)	1.5W
Supply Tolerance	±10%		
Power Reset	100 msec minimum		

GENERAL SPECIFICATIONS	
Relay Contacts	2 x 5A @ 250VAC
Standards	CE Rated
Enclosure Protection Rating	IP40
Weight	100gm (approximately)

Note: Function Test Mode is achieved by adjusting the dial fully anticlockwise. This will result in the unit performing the set function with a time base (t) = 5 sec.

TIME SPECIFICATION	
Setting Accuracy	Maximum of ±5% full scale ±50msec
Repeatability	Maximum of ±0.3% of full scale ±10msec (in 1 sec time range)
Temperature Influence	Maximum of ±2% of full scale
Influence of Supply Voltage Variance	Maximum of ±0.5% of full scale ±10msec (in 1 sec time range)
Power Reset Time	100msec minimum

SETTINGS		
TIME SETTING	SCALE SETTING	
	1	10
Sec	0.1 sec to 1 sec	1 to 10 sec
Min	0.1 min to 1 min	1 to 10 min
Hrs	0.1 hr to 1 hr	1 to 10 hrs
10 Hrs	1 hr to 10 hrs	10 to 100 hrs

Additional information in Section J, page 131.

HOW TO ORDER

48 x 48 Timers

■ Ordering Code

